




CTS (NINGBO) TESTING SERVICE TECHNOLOGY INTERNATIONAL

OPERATE ACCORDING TO ISO/IEC 17025

EMC TEST REPORT

TEST REPORT NUMBER : CNB3140220-00097-E-R1

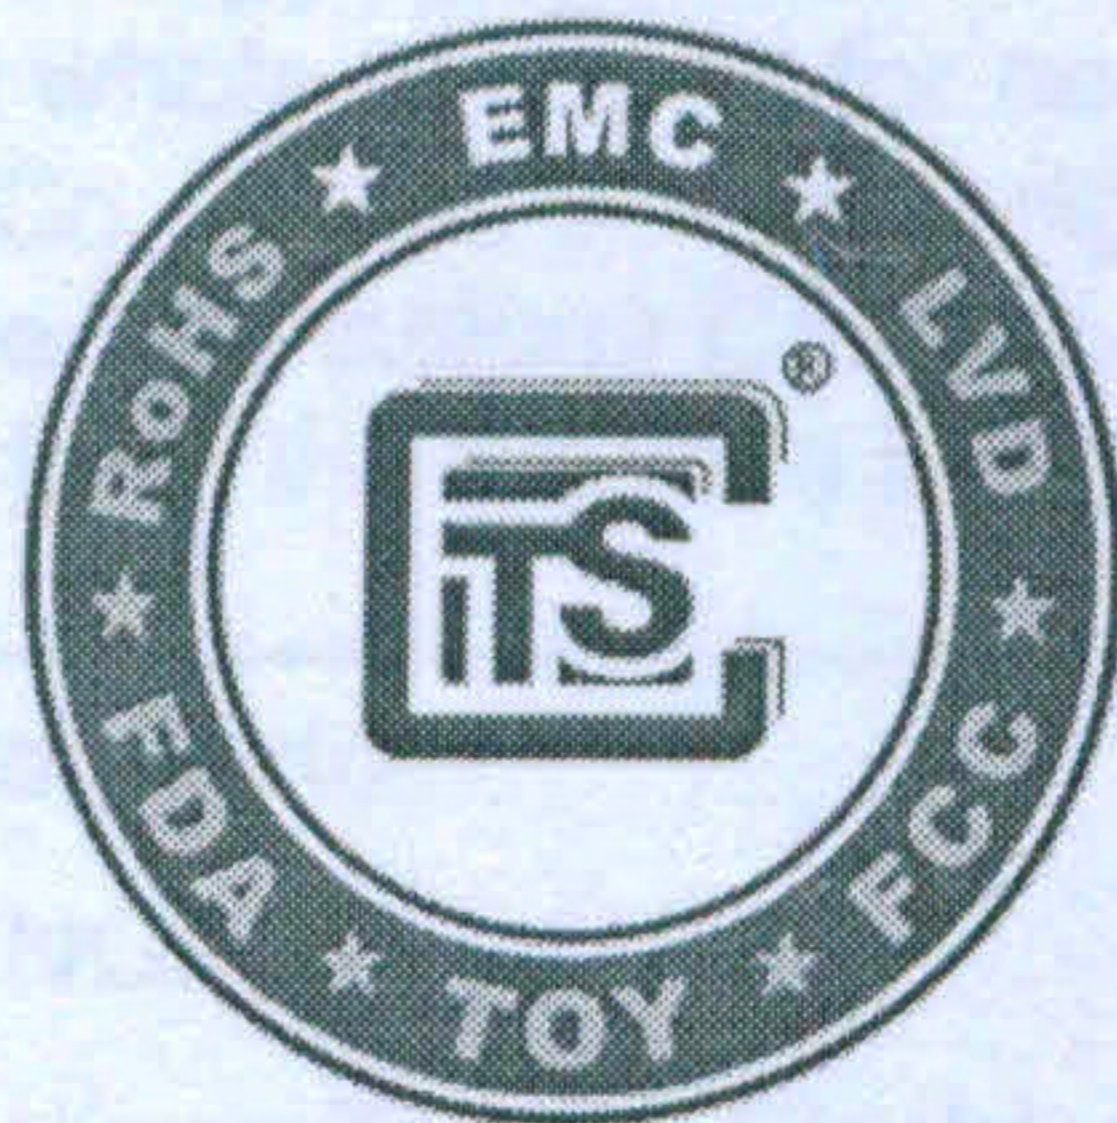

CTS (Ningbo) Testing Service Technology Co., Ltd.
2/F., South Tower, Huoju Building, No.181, Canghai Road,
Jiangdong Science and Technology Park, Ningbo, Zhejiang, China



CTS

CENTRE OF TESTING SERVICE

| | |
|---|--|
| TEST REPORT | |
| EN 60947- 1: 2007+A1:2011 | |
| Low-voltage switchgear and controlgear---Part 1: General rules only for EMC | |
| Report Reference No. | CNB3140220-00097-E-R1 |
| Date of issue | 29 April 2014 |
| Testing Laboratory Name | CTS (Ningbo) Testing Service Technology Co., Ltd. |
| Address | GZ test site: A101, No.65, Zhuji Road, Tianhe District, Guangzhou, Guangdong, China |
| Testing location/ procedure | Full application of Harmonised standards <input checked="" type="checkbox"/> Partial application of Harmonised standards <input type="checkbox"/> Other standard testing method <input type="checkbox"/> |
| Applicant's name | Zhejiang Tengen Electrics Co.,Ltd. |
| Address | Tengen Industry Zone,Liushi,Yueqing,Zhejiang,P.R.China |
| Test specification: | |
| Standard | EN 60947- 1: 2007+A1:2011 |
| Test Report Form No. | CTSEMC-1.0 |
| TRF Originator | CTS (Ningbo) Testing Service Technology Co., Ltd. |
| Master TRF | Dated 2009-01 |
| CTS (Ningbo) Testing Service Technology Co., Ltd. All rights reserved. This publication may be reproduced in whole or in part for non-commercial purposes as long as the CTS (Ningbo) Testing Service Technology Co., Ltd. is acknowledged as copyright owner and source of the material. CTS (Ningbo) Testing Service Technology Co., Ltd. takes no responsibility for and will not assume liability for damages resulting from the reader's interpretation of the reproduced material due to its placement and context. | |
| Test item description. | Foot Switch |
| Trade Mark | TENGEN |
| Manufacturer | Zhejiang Tengen Electrics Co.,Ltd. |
| Model/Type reference | EKW-5A |
| Ratings | Ith:5A AC-15 Ue: AC380V, Ie: 0.8A DC-13 Ue: DC220V, Ie: 0.16A |
| Result | PASSED |

Compiled by:

Kate zhang /File administrators

Supervised by:

Duke yang / Technique principal

Approved by:



Vincent yao / Manager

Right of this report is owned by Centre of Testing Service and may not be reproduced other than in full except with the written approval of the issuing Company.

(Ningbo) Testing Service Technology Co., Ltd.

South Tower, Huoju Building, No.181, Canghai Road, Jiangdong Science and Technology Park, Ningbo, Zhejiang, China

+86-20-85543113 (32 lines)
Hotline: +86-20-85533471

Fax: +86-20-38780406
E-mail: cts@cts-lab.com.cn

See Reverse For Terms And Conditions of Service